

PI Tuning of Shunt Active Power Filter Using Optimization Techniques

Gowtham N* and Shobha Shankar*

Abstract : The PI controller plays important role in all engineering controls. The tuning of PI controller is generally done with institutive methods, which is less effective. This paper discusses about the PI controller tuning which affects the results of the total harmonic distortion (THD) of the active power filter. The active power filter is designed for reducing the THD in non-linear load connected power system. It is identified that the variation of proportional constant (Kp) and Integral constant (Ki) affects the THD value. So a problem is formulated to minimize the THD value of the system to find the optimal Kp, Ki parameters. The well-known optimization techniques like genetic algorithm (GA) and Particle swarm optimization (PSO) are used to find the optimal value of Kp and Ki and in turn minimize THD. MATLAB Simulink, Sim power system and optimization tool boxes are used.

Keywords : Active Power Filter (APF), Genetic Algorithm (GA), PI tuning and Particle Swarm Optimization (PSO).

1. INTRODUCTION

The power quality is very important nowadays as the need of energy is increasing. The active power filter is used for improving the power quality in the non-linear load connected to the power system. In single phase and three phase system rectifiers or front end converters produces the problem of lower order harmonic injection [1]. Active filter system reduces this problem by injecting the current [2]. There are two types of active power filters, they are shunt and series compensation. The shunt takes care of the current injection and series takes care of voltage injection. Mainly shunt active filters are given priority as it handles the current because current is load dependent [3]. The inverter is used to inject the current to the supply system. The hysteresis control is used for reducing the complexity of PWM generation and current which is to be injected is derived and used as the control technique [4]. A notch based filter is useful in selecting a particular harmonic and removing it. The phase lock loop is eliminated to synchronize with the control part [5].

The Genetic algorithms are also used in the switching of inverters in active power to optimally initialize the switching of inverter, which increases the switching time faster in the initial condition [6]. The control technique used for controlling the pulses is taken from the reference generation of current. Genetic Algorithm is used to produce the reference current, which makes the control faster compared to conventional methods [7]. The hybrid passive filters are introduced to compensate the reactive power as well as harmonics, which has lesser size of inductance [8]. Adaptive filter design is made for synchronization detection and harmonic extraction, which can be used in the Flexible AC Transmission Systems (FACTS) [9]. A robust control strategy with boost converter is presented by the authors in [10] for shunt active filter to improve the performances of the filter.

* Department of Electrical and Electronics Engineering, Vidyavardhaka College of Engineering, Mysuru -570 002, Karnataka, India
E-Mail: shobha.shankar@vnce.ac.in

The upgrade of inverter control strategies also improves the performance of the active filters. A new vector control based hysteresis control is made for improving the transient performance of the system [11]. A non-linear optimal predictive control to improve the stability and robustness of the shunt active filter [12]. The control algorithm is improved to reduce the switching nodes are presented in [13]. The power system is not dealing with three wires (RYB). It also uses four wires (RYBG). A non-linear control strategy is used in [14] to control the power factor with 4-wire system to improve power factor in asymmetrical and non-linear loading condition. A new control strategy with dq-axis is presented in [15] to improve the performance of the shunt active filter. Proportional integral (PI) and Proportional Integral Derivative (PID) based Active power line conditioner is used to improve the power factor is presented in [16, 17]. The analytical analysis of shunt active filter is done for improving the stability and power factor is presented in [19]. The pq theory is meant for identifying the power component. A literature [20] describes that the instantaneous nature of pq is not considered and while considering it gives better results. It is known as Instantaneous reactive power theory. And it is described in analytical method for improving the stability [21]. The unified power quality conditioner is nothing but the combination of shunt and series compensator. It provides the sag and swell compensation of voltage and harmonic compensation in current [22].

Optimization is very important in engineering to improve the efficiency of the existing system. The PI tuning problem of shunt active filters is not considered in any literature. This problem is formulated and the solution is made with genetic algorithm [18, 23] and Particle swarm optimization [23] are used to find the optimum values of K_p and K_i with minimization of THD.

2. PROBLEM DEFINITION

The DC link voltage is controlled with PI controller. This PI controller is responsible for total harmonic distortion.

$$I_c = K_p * (V_{dc\ ref} - V_{dc*}) + K_i * \int_0^t (V_{dc\ ref} - V_{dc*}) dt \quad (1)$$

Here,

- I_c = Compensation current
- V_{dc*} = DC measured voltage at DC link
- $V_{dc\ ref}$ = DC reference voltage
- K_p = Proportional constant
- K_i = Integral constant

Objective function is

$$\text{Minimize } \sum_{i=0}^n \text{mean (THD)} \quad (2)$$

Subjected to

$$P1 \leq K_p \leq P2(3) \quad (3)$$

$$I1 \leq K_i \leq I2 \quad (4)$$

Here,

- n = Total number of samples
- P1 = lower limit of K_p value
- P2 = Upper limit of K_p value
- I1 = Lower limit of K_i value
- I2 = Upper limit of K_i value

The reason for utilizing the non-parametric optimization techniques is that the development of the transfer function for the UPQC as a whole as a single entity and tuning it would become a complex task, thus avoided it to follow the numerical optimization methods like the GA and the PSO.

3. SOLUTION METHODS

There are many solution algorithms available in meta-heuristics. GA and PSO algorithms are used due its simplicity.

A. Genetic Algorithm

Genetic algorithms are based on natural genetics and natural selection. The good properties of parents will produce the child. The natural genetic operations are reproduction, crossover and mutation[23]. Reproduction is used to select the good strings with a probability constant. It is known as probability of reproduction. The equation can be written as

$$P_i = \frac{F_i}{\sum_{j=1}^n F_j} ; i = 1, 2, \dots, n ; j = n + 1 \quad (5)$$

P_i – Mating poll

F_i – Fitness function

Crossover is used to create a new strings by exchanging the information among the strings. Mutation is the better fitness values for new generations. The mutation probability changes between 1 and 0. The solution steps are as follows,

Read the input data like population size, string length, probability of cross over (p_c), probability of mutation (p_m). Populate random k_p and k_i values (size m).

- Evaluate the fitness equation (2).
- Carry out the reproduction process
- Carry out the crossover operation using the crossover probability p_c .
- Carry out mutation using probability p_m to find new generation (m).
- Do the step 2.
- Check for end of iteration.
- Stop and show the result.

B. Particle Swarm Optimization

The PSO algorithm is based on the food searching behavior of the birds or fishes, which is taken as particles. The particle which can get the food faster is made as a mathematical algorithm. The steps of the algorithm is given below,

- Assume the swarm number is N .
- Generate the K_p and K_i values. This is called as intial population (X).
- Evaluate the objective function (2).
- Find the velocities of the particles. Using the below equation.

$$V_j(i) = V_j(i-1) + C_1 r_1 [P_{\text{best}, j} - X_j(i-1)] + C_2 r_2 [G_{\text{best}, j} - X_j(i-1)] ; \quad (6)$$

$$j = 1, 2, \dots, N.$$

where,

V – velocity of the particle

i – iteration number

j – particle number

P_{best} – Particle best

G_{best} – Global best

c_1, c_2 – cognitive and social learning rates (chosen as 2)

r_1, r_2 – uniformly distributed random numbers in range 0 and 1.

- Update the X values using the following equation,

$$X_j(i) = X_j(i-1) + V_j(i); j = 1, 2, \dots, N \quad (7)$$

- Do the step 3 till the end of iteration count.
- Check for convergence.

4. SHUNT ACTIVE POWER FILTER WITH TUNING ALGORITHM

The above figure shows the control diagram of the proposed model. The reference dc voltage is given to the comparator. The other side of the comparator is given from the measured V_{dc} . The output of the comparator is given to the PI controller where the K_p and K_i parameters are used. The output of the PI controller is given to the control loop of current in the shunt active power filter (SAPF). The total harmonic distortion (THD) is taken out and given to the objective function. The algorithms generate initial random population of the K_p & K_i parameters. So till the optimum results are reached the algorithm run and produce the optimum value of K_p and K_i value with lesser THD.

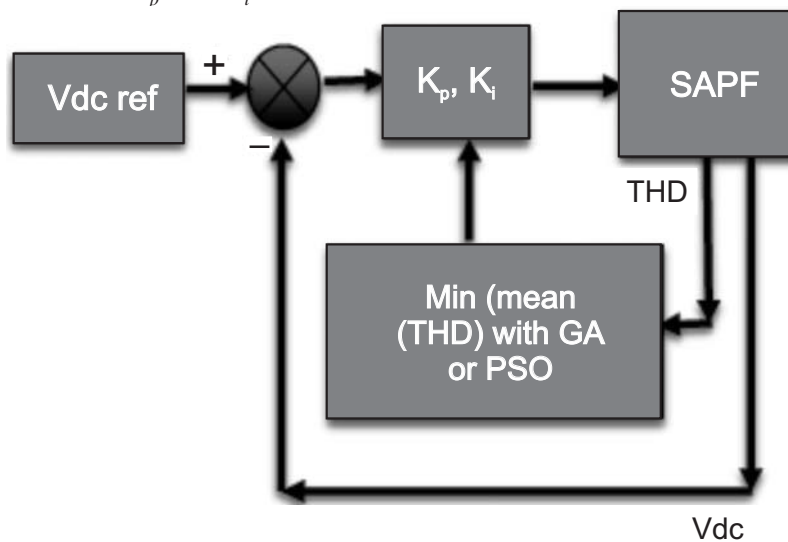


Figure 1: Block diagram of the proposed system

5. RESULTS AND DISCUSSIONS

The simulation is carried out using the parameters given in table 1. The non-linear load taken here is rectifier with RL load. Due to the non-linear load the waveforms are taken as shown in the figure 3.

Table 1
Parameters of SAF

Parameters	Ratings
Phase voltage & frequency	310V, 50 Hz
Line impedance	$R_s = 1 \Omega$, $L_s = 0.1\text{mH}$
R-C load	$R_L = 32 \Omega$, $C_L = 500\mu\text{F}$
R-L load	$R_L = 26 \Omega$, $L_L = 10\text{mH}$
DC bus voltage & capacitance	$V_{dc} = 500\text{V}$, $C_{dc} = 2000 \mu\text{F}$
Shunt active filter ratings	1.81 KVA

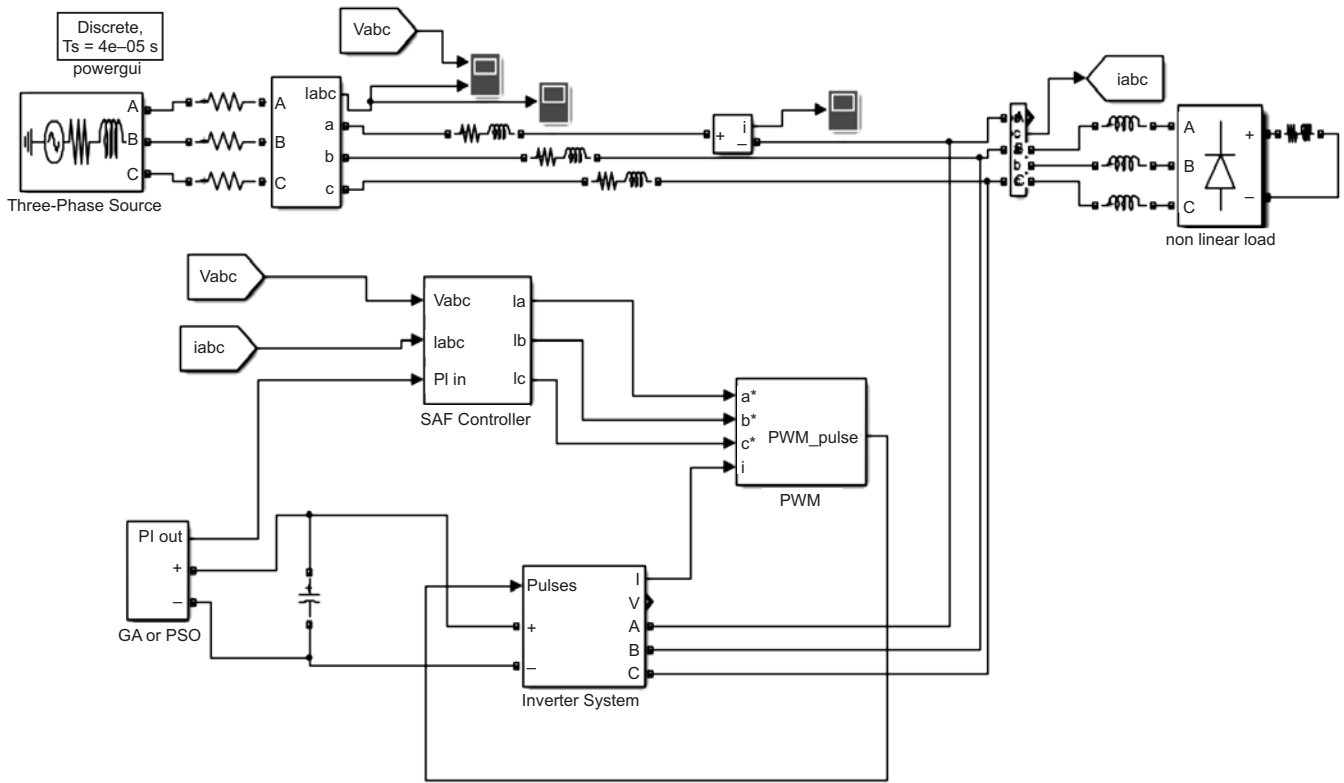


Figure 2: Simulink model of the test system

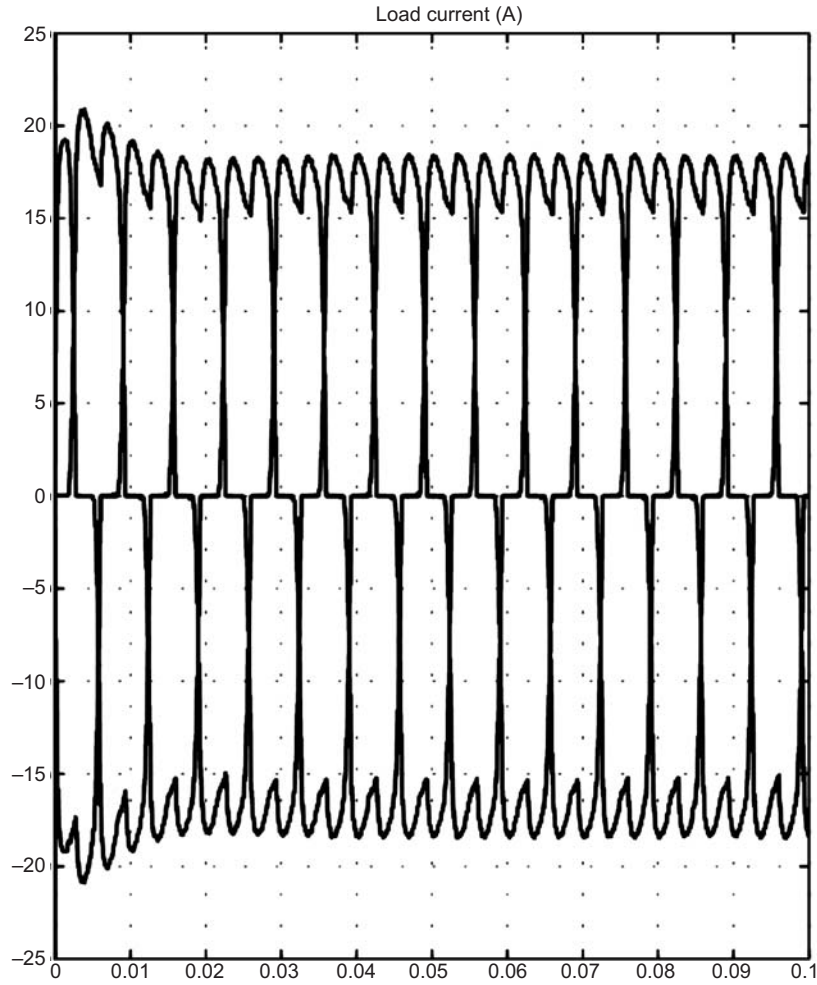


Figure 3: Three phase current waveform before compensation

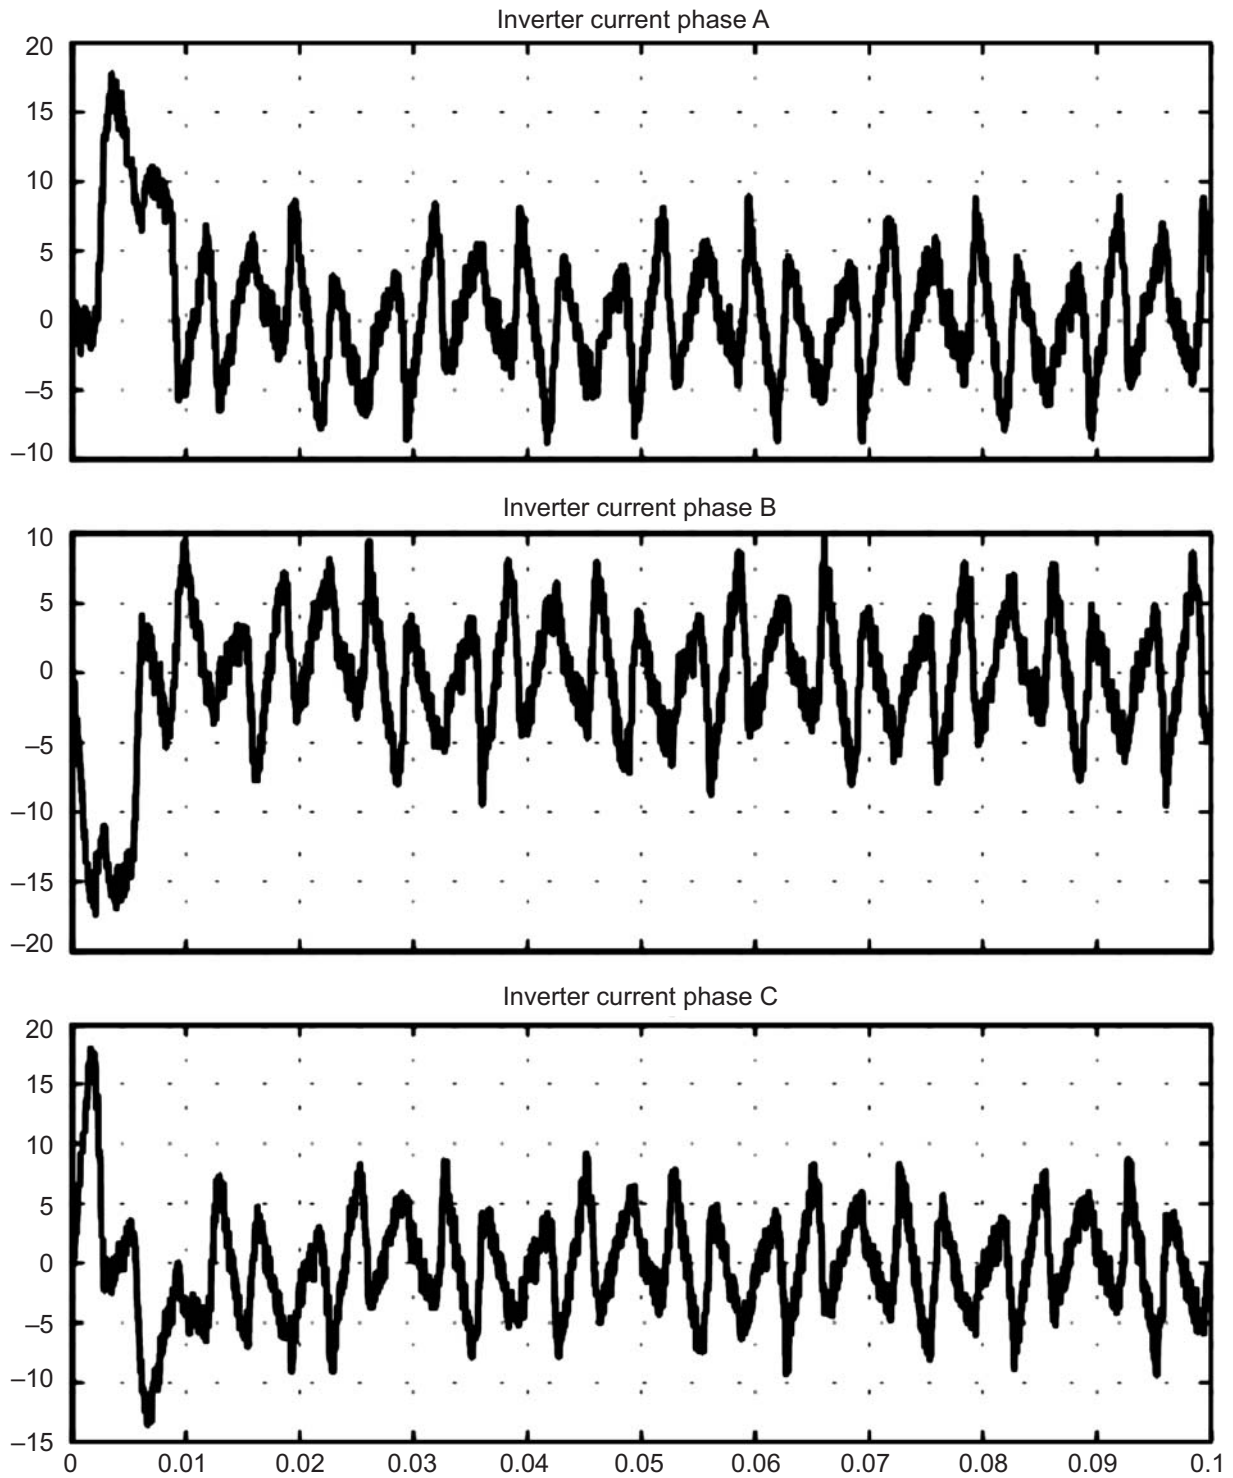


Figure 4: Compensation current produced by the controller

Table 2

Comparison of GA and PSO algorithm

<i>Parameters</i>		<i>GA</i>	<i>PSO</i>
THD(%)	Before compensation	15.76	17.87
	After compensation	4.7769	4.7545
Optimal Kp		0.000979	0.000531
Optimal Ki		0.001306	0.001658

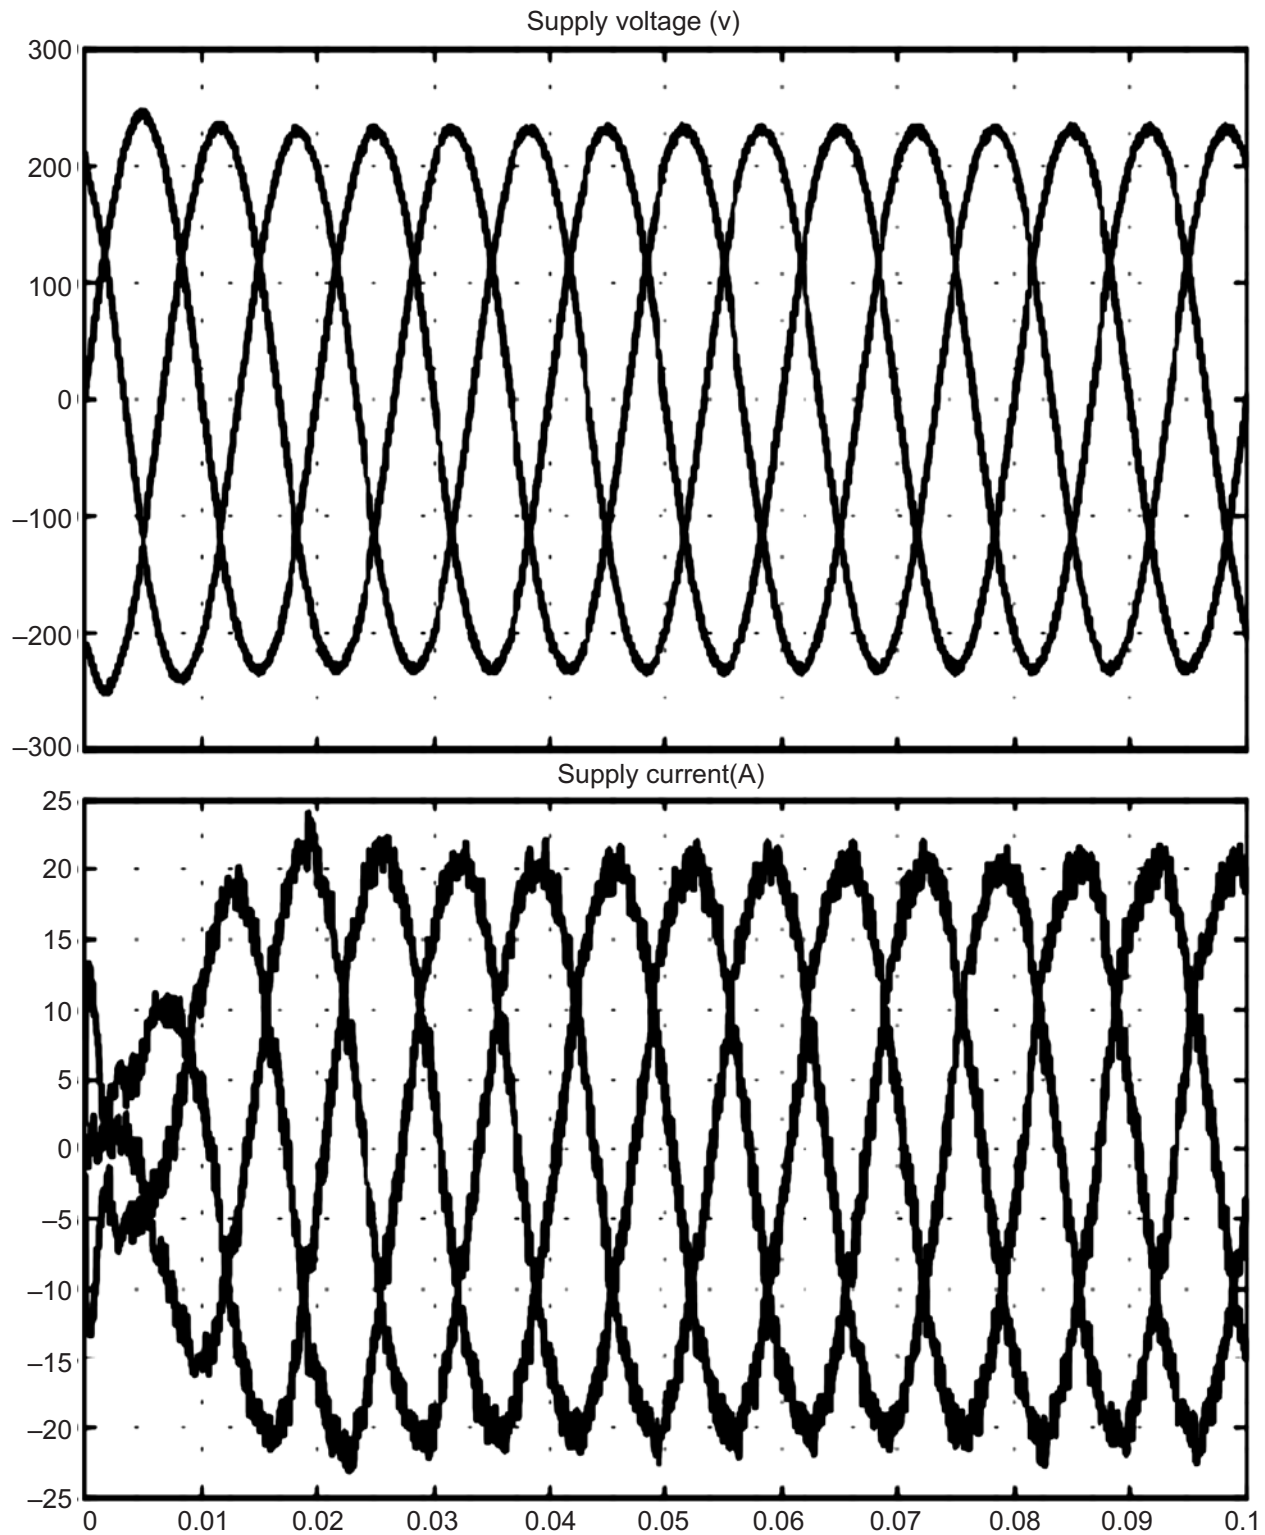


Figure 5: Three phase voltage and current after compensation

The figure 3 shows the convergence graph of the GA algorithm. The graph shows the THD value nearly 4.77 % which satisfies the IEEE standard for THD.

The parameters used are given below (for both GA and PSO),

Population size (initial value) : 20

Number of Variables : $2(K_p, K_i)$

Range of Variables : 0-0.002

Maximum iteration : 100

The above figure shows the results of PSO algorithm after solving the objective function. The solution converges in 4.755 % of THD. And it is less compared to the GA method.

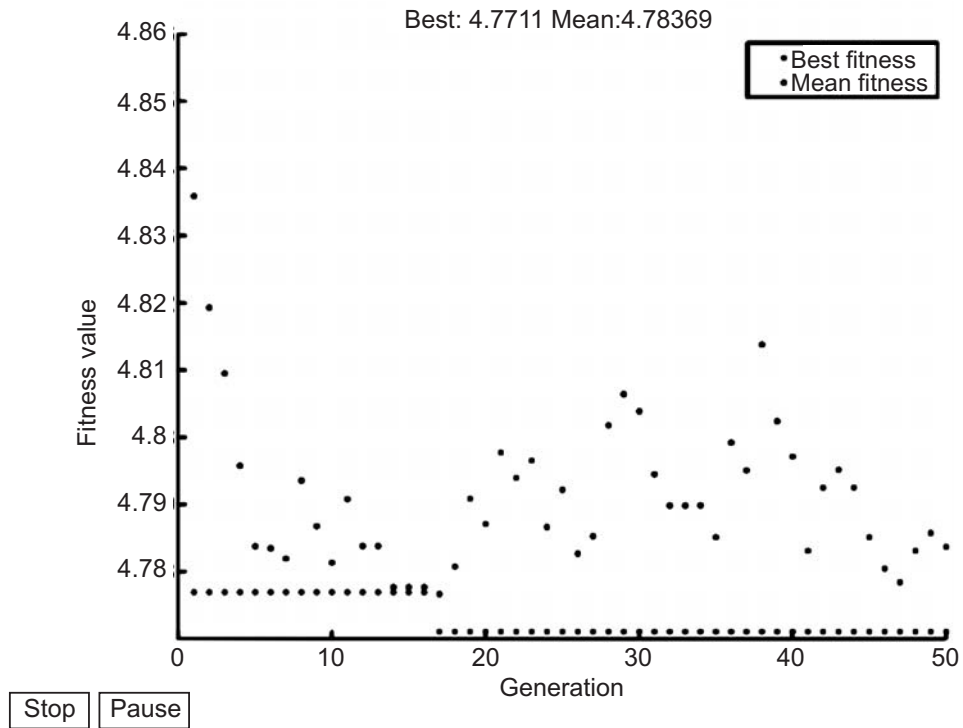


Figure 6: Convergence graph of Genetic Algorithm (GA)

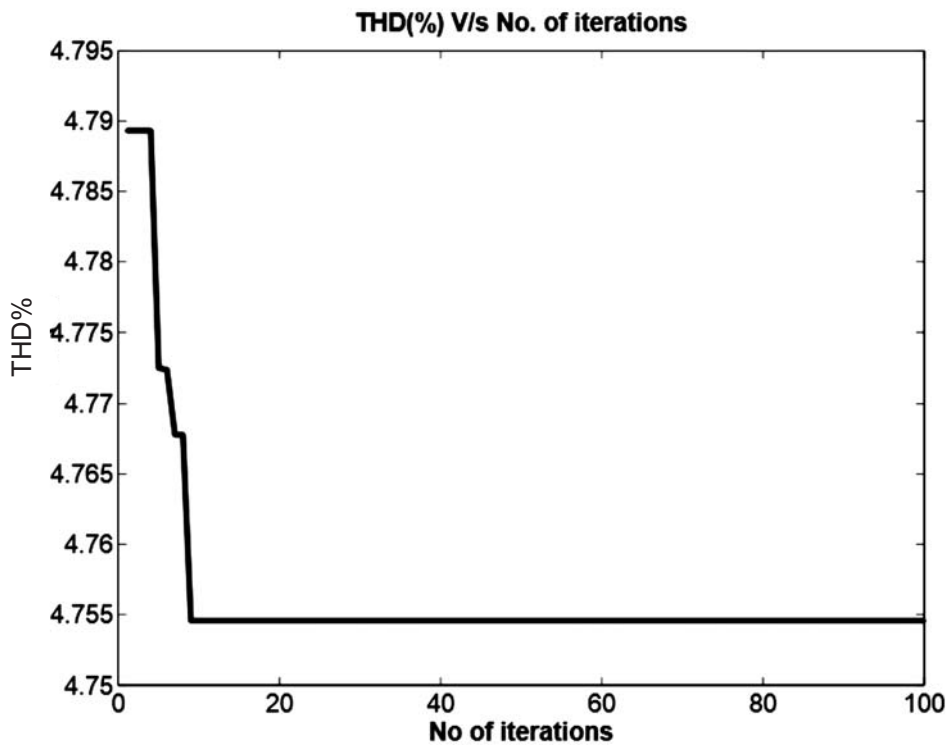


Figure 7: Convergence graph of PSO algorithm

6. CONCLUSION

The shunt active filter is designed with PI controller and pq theory. The parameter optimization of the shunt active filter is done with two algorithms GA and PSO. The THD value minimization is taken as objective and it is minimized. The optimal values of k_p and k_i values varies with algorithm and the THD value is

also varied. Finally PSO algorithm gives better results compared to GA. The optimal value of k_p and k_i values are identified. The tuning algorithm using PSO has performed better than the GA method, but both the methods provided the THD values less than the allowed 5% as mentioned by the IEEE standard 519.

7. REFERENCES

1. A. Sedra, G. W. Roberts and F. Gohh, "The current conveyor: history, progress and new results," Ned Mohan 2002, 'Power Electronics: Converters, Applications, and Design' 3rd Edition', Wiley publications
2. Bhattacharya, S Frank, TM, Divan, DM & Banerjee, B 1998, 'Active filter system implementation', IEEE Ind. Appl. Mag., 4(5): 47–63.
3. Bhattacharya, C. Chakraborty, & Bhattacharya, S 2009, 'Current compensation in shunt type active power filters', IEEE Ind. Electron. Mag., 3(3): 38–49.
4. Bhim Singh, Kamal Al-Haddad & Ambrish Chandra 1999, 'A New Control Approach to 3-phase Active Filter for Harmonics and Reactive Power Compensation', IEEE Trans. on Power Systems, 46(5):133–138.
5. Davood yazdani, Alireza Bakhshai & Praveen K.Jain 2010, 'A Three- phase Adaptive Notch filter based Approach to Harmonic /Reactive current extraction and harmonic decomposition', IEEE Transactions on Power electronics, 25(4): 914-922.
6. El-Habrouk, M & Darwish, M, K 2002, 'A new control technique for active power filters using a combined genetic algorithm conventional analysis', IEEE Transactions on Industrial Electronics, 49(1):58-66.
7. Gonzalez, SA, Garcia-Retegui, R, & Benedetti, M 2007, 'Harmonic computation technique suitable for active power filters', IEEE Trans. Ind. Electron., 54(5): 2791–2796.
8. Hamadi, A, Rahmani, S & Al-Haddad, K 2010, 'A hybrid passive filter configuration for VAR control and harmonic compensation', IEEE Trans. Ind. Electron., 57(7): 2419–2434.
9. Karimi, H, Karimi-Ghartemani, M, & Irvani, MR 2003, 'An adaptive filter for synchronous extraction of harmonics and distortions', IEEE Trans. Power Del., 18(4): 1350- 1356.
10. Marconi, L, Ronchi, F & Tilli, A 2004, 'Robust perfect compensation of load harmonics in shunt active filters', in Proc. 43rd IEEE Conf. Decision Contr., 3: 2978–2983.
11. Mansour Mohseni, Syed. M. Islam 2010, 'A New Vector based Hysteresis Current Control Scheme for three phase PWM Voltage Source Inverters', IEEE Trans. Power Elec., 25(9):2299-2309
12. Mendalek, N, Fnaiech, F, Al-Haddad, K & Dessaint, LA 2002, 'A non- linear optimal predictive control of a shunt active power filter', in Conf. Rec. IEEE 37th Ind. Appl. Soc. Annu. Meeting, 1: 70–77.
13. Singh, BN, Singh, B, Chandra, A, Rastgoufard, P & Al-Haddad, K 2007, 'An improved control algorithm for active filters', IEEE Trans. Power Del., 22(2): 1009–1020.
14. Sommer, JR, Espinoza, JR & Moran, LA 2006, 'A non-linear control strategy for instantaneous power factor correction in 3- 4-wire electrical systems under asymmetrical and non-linear loads', in Proc. Int. Symp. Ind. Electron. 2: 1206–1211.
15. Salem Rahmani, Abdelhamid Hamadi, 2009, 'A New Control Technique for Three-Phase Shunt Hybrid Power Filter', IEEE Transactions On Industrial Electronics, Vol. 56, No. 8.
16. Karuppanan, P & Kamal Kanta Mahapatra 2010, 'PI with Instantaneous Power theory based shunt APLC for power quality', National conference on Emerging technological Trends (NCETT-2010).
17. Karuppanan, P & Kamala kanta Mahapatra 2010, 'PID with PLL Synchronization controlled Shunt APLC under Non-sinusoidal and Unbalanced conditions', National Power Electronics Conference (NPEC) Proceedings, IIT-Roorkee.
18. Kennedy, J, Eberhart, RC, 1995 'Particle Swarm Optimization' 1995 IEEE International conference on neural network, Vol.4 Piscataway, NJ Institute of Electrical and Electronics Engineers pp.1942-48.
19. Kuo, H, Yeh, SN & Hwang, JC 2001, 'Novel analytical model for design and implementation of three-phase active power filter controller', Proc. Inst. Elect. Eng.—Electr. Power Appl., vol. 148, no. 4, pp. 369–383.
20. Leszek, S, Czarnecki 2006, 'Instantaneous Reactive Power p-q Theory and Power Properties of Three-Phase Systems', IEEE Trans on Power Vol.21, No. 1, pp 362-367.
21. Liao, JC & Yeh, SN 2000, 'A novel instantaneous power control strategy and analytical model for integrated rectifier inverter systems', IEEE Trans. Power Electron., vol. 15, no. 6, pp. 996–1006.
22. Luis, FC, Monteiro, Jose, C, Costa, C, Mauricio Aredes, & Joao Lafonso 2005, 'A Control Strategy for Unified Power Quality Conditioner' Brazilian power electronics conference.
23. Singiresu S. Rao, 2009, "Engineering Optimizatoion: Theory and Practice", wiley publications.